



# Angle Isolation Valve Installation Instructions



Ambient

-60—+175°F


-51—+79°C



Operating Media

-40—+300°F

-40—+149°C

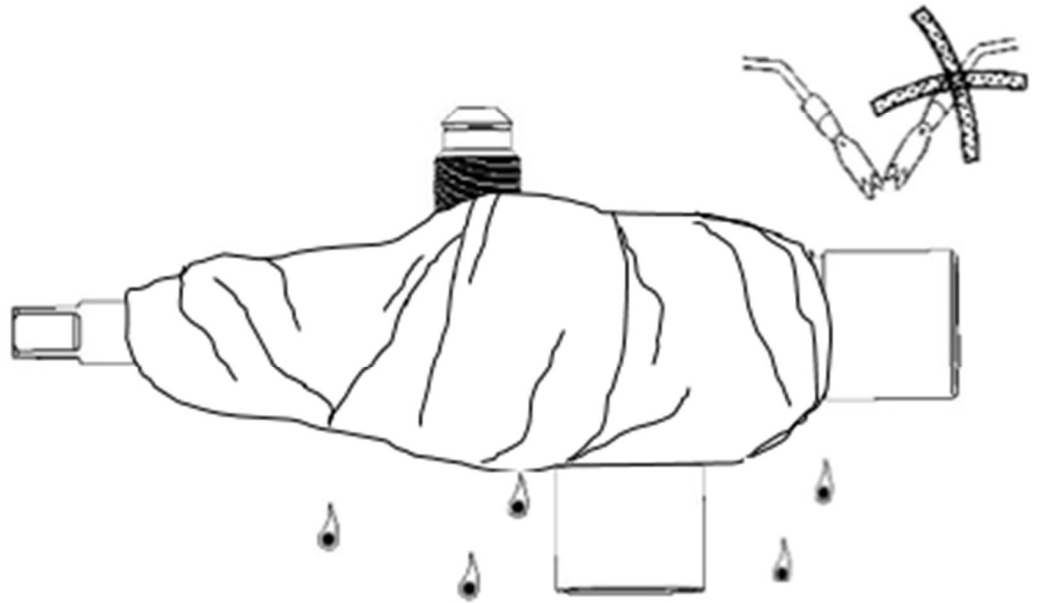

## Notes:

- Ensure application does not exceed pressure stamped on valve.
- Failure to wet wrap during installation may result in irreparable damage.
- For use with CFC, HFC, HCFC, AND HFO refrigerants listed in CAN/CSA B52 and ANSI/ASHRAE 15, sec. 9.2 where saturation vapor pressure at 125°F (high side) and 80°F (low side) is less than the Maximum Design Working pressure. After charging, mark unit with refrigerant type and oil used. Not suitable for use with ammonia (R717).